

UK-Type Examination Initial CERTIFICATE

according to
The Pyrotechnic Articles (Safety) Regulations 2015,
SI 2015 No. 1553 as amended Part 3. 40, Module B

Certificate No.: PB 008959 001

Test Report No.: see Annex A

Assessment Report No.: 11010726 001-A

Manufacturer: YG Yangın Güvenliği San. ve Dış Tic. Ltd. Şti.
Post Code: 34418, YESILCE MAH. DEMIRBAS SOKAK No: 20 KAGITHANE /
ISTANBUL / TÜRKİYE

Generic type: Smoke / aerosol generator

Subtype: Pyrotechnic fire-fighting device

Category: P1

Registration number: 2806 – P1 – 008959

Tested according to: EN 16263-1:2015; EN 16263-2:2015; EN 16263-3:2015; EN 16263-4:2015, EN 16263-5:2015

Identification of items: PFE-1 PFE-3
(code by manufacturer)

This certificate refers to the above mentioned product. This is to certify that the test sample is in conformity with the Essential Safety Requirements of SCHEDULE 2 of The Pyrotechnic Articles (Safety) Regulations 2015, SI 2015 No. 1553 as amended. The manufacturer is entitled to use this certificate in connection with the Declaration of Conformity in accordance with the Regulation. This certificate does not imply assessment of the series-production of the product and does not permit the use of a CerTrust mark of conformity.

UKAS accredited certification body No. 22950.

ANNEX A – Detailed identification of articles

ANNEX B – Instruction for safe use, storage and disposal

Date of Issue:

Budapest, 21.10.2024

UK Approved Body 2806



Imre Diószegi

Annex A for certificate of UK-type examination

Detailed identification of articles

Certificate No.: **PB 008959 001**

Test Report No.: **11003478 001** Assessment Report No.: **11010726 001-A**

Generic type: **Smoke / aerosol generator** Subtype: **Pyrotechnic fire-fighting device**

Category: **P1**

Registration number: **2806 – P1 – 008959**



Manufacturer code: **PFE-1**

Name of product.....: **PORTABLE CONDENSED AEROSOL FIRE EXTINGUISHIN GAS GENERATOR**

Dimensions (mm)		Weight (g)		Other parameters
Height:	242	NEC:	50	
Width:	-	Gross mass:	500	
Length:	-			
Outer diameter:	50			

Other information.....:

PFE-1

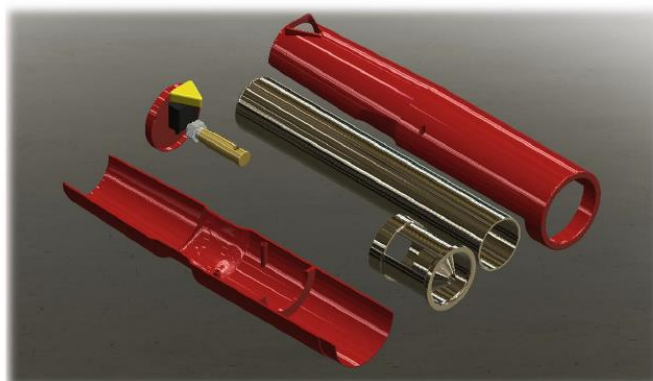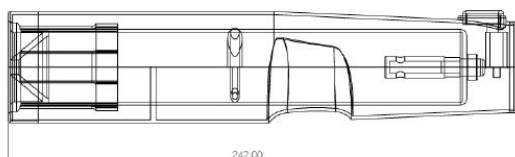

Annex A for certificate of UK-type examination

Detailed identification of articles

Certificate No.: **PB 008959 001**

Test Report No.: **11003478 002** Assessment Report No.: **11010726 001-A**

Generic type: **Smoke / aerosol generator** Subtype: **Pyrotechnic fire-fighting device**

Category: **P1**


Registration number: **2806 – P1 – 008959**

Manufacturer code: **PFE-3**

Name of product.....: **PORTABLE CONDENSED AEROSOL FIRE EXTINGUISHIN GAS GENERATOR**

Dimensions (mm)		Weight (g)		Other parameters
Height:	237	NEC:	150	
Width:	97	Gross mass:	1720	
Length:	97			
Outer diameter:	—			

Other information.....:

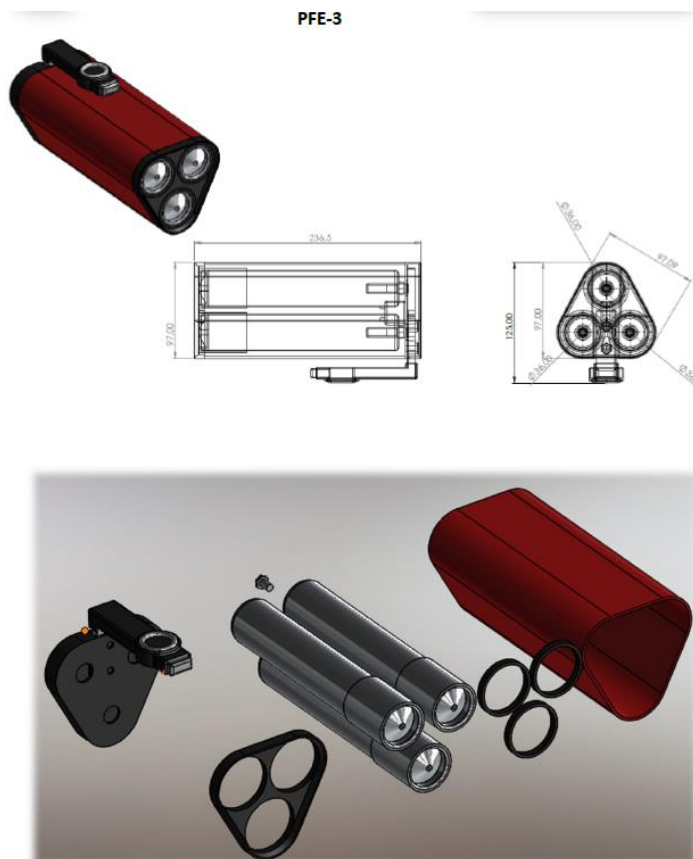

ANNEX B
for certificate of UK-type examination

Instruction for safe use, storage and disposal

Certificate No.: PB 008959 001
Generic type: Smoke / aerosol generator
Subtype: Pyrotechnic fire-fighting device
Category: P1
Registration number: 2806 – P1 – 008959

Code / Name given by the Manufacturer

PFE-1 / PORTABLE CONDENSED AEROSOL FIRE EXTINGUISHIN GAS GENERATOR

PFE-3 / PORTABLE CONDENSED AEROSOL FIRE EXTINGUISHIN GAS GENERATOR

Instruction of use: Article to be used in accordance with written instructions and national regulations.

Shelf-life: The expiration date specified by the manufacturer or importer.

Storage conditions: Must be protected from moisture, direct heat and impact.
In accordance with labelling and national legislation.

Instruction for disposal: In accordance with labelling and national legislation.